

Master cable - SAC-12P- 5,0-PUR/M16FR - 1693720


Please be informed that the data shown in this PDF Document is generated from our Online Catalog. Please find the complete data in the user's documentation. Our General Terms of Use for Downloads are valid (<http://phoenixcontact.com/download>)



Master cable, application: Sensor/actuator box, connection method: M8 socket Metal, number of slots: 8, number of positions: 12, slot assignment: single, status display: No; master cable connection: M16 plug connection, PUR/PVC, cable length: 5 m, shielding: no



Key Commercial Data

| | |
|--------------|---|
| Packing unit | 1 pc |
| GTIN |  4 017918 189068 |
| GTIN | 4017918189068 |
| Sales Key | 02 |

Technical data

General

| | |
|-----------------------------------|----------------------|
| Rated voltage | 125 V AC 150 V DC |
| Number of positions | 12 |
| Number of slots | 8 |
| Sensor/actuator connection system | M8 socket |

Ambient conditions

| | |
|---------------------------------|--|
| Degree of protection | IP67 |
| Ambient temperature (operation) | -25 °C ... 90 °C (Plug / socket) -40 °C ... 90 °C (for fixed installation) -5 °C ... 80 °C (for flexible installation) |

Master cable data/connection data

| | |
|---------------------------|--|
| Connection method | M16 plug connection |
| Length of cable | 5 m |
| Cable type | Master cable suitable for flexible cable conduit |
| Signal line cross section | 8x 0.34 mm ² |
| AWG signal line | 22 |

Master cable - SAC-12P- 5,0-PUR/M16FR - 1693720

Technical data

Master cable data/connection data

| | |
|-------------------------------------|-------------------------|
| Conductor structure signal line | 42x 0.10 mm |
| Power supply cross section | 2x 0.75 mm ² |
| AWG power supply | 18 |
| Conductor structure, voltage supply | 96x 0.10 mm |
| External diameter | 8.7 mm |
| Max. bending cycles | 1500000 |
| Bending radius | 100 mm |
| Traversing path | 2 m |
| Traversing rate | 2 m/s |

Insulation material

| | |
|--|---------------|
| Housing material | PUR |
| Material of contact, master cable side | CU alloy |
| Material of contact surface, master cable side | Gold-plated |
| Material of the contact carrier on the master cable side | TPU |
| Material of threaded sleeve | Cu alloy |
| Material of threaded sleeve surface | Nickel-plated |
| Sealing material | NBR |

Connection assignment

| | |
|---------------------------------------|--------------------------|
| Slot/position = pin = conductor color | 1 / 4 (A) = P = WH |
| | 2 / 4 (A) = J = GN |
| | 3 / 4 (A) = T = YE |
| | 4 / 4 (A) = S = GY |
| | 5 / 4 (A) = G = PK |
| | 6 / 4 (A) = R = RD |
| | 7 / 4 (A) = E = BK |
| | 8 / 4 (A) = O = VT |
| | 1-8 / 3 (0 V) = L+U = BU |


Environmental Product Compliance

| | |
|------------|---|
| REACH SVHC | Lead 7439-92-1 |
| China RoHS | Environmentally Friendly Use Period = 50 years |
| | For details about hazardous substances go to tab "Downloads", Category "Manufacturer's declaration" |

Drawings

Master cable - SAC-12P- 5,0-PUR/M16FR - 1693720

Circuit diagram

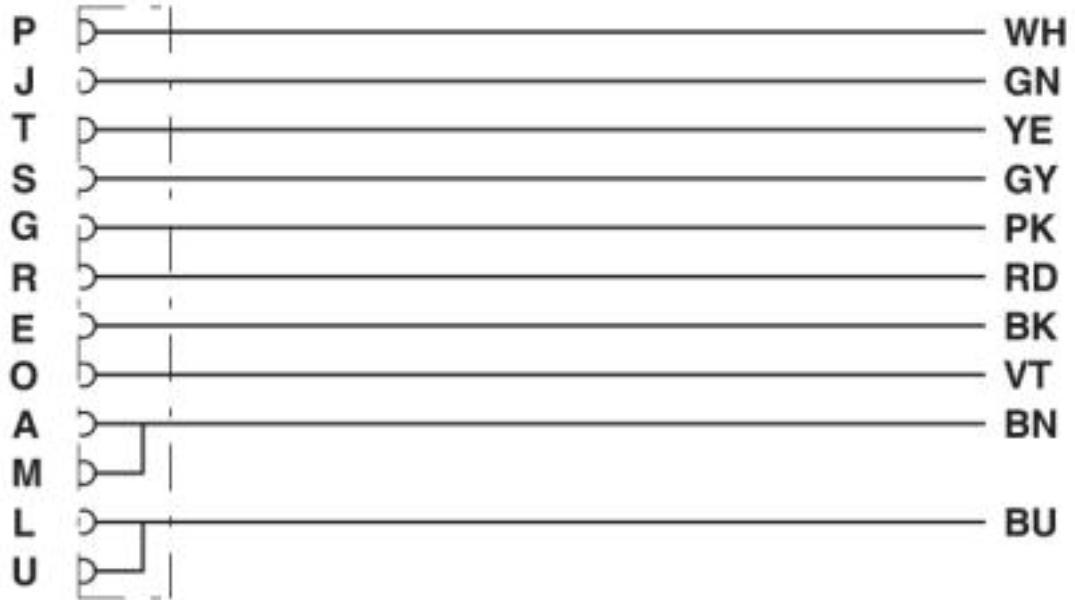

Contact assignment of the M16 socket

Master cable - SAC-12P- 5,0-PUR/M16FR - 1693720

Cable cross section



PUR/PVC black [PUR]

Classifications

eCl@ss

| | |
|---------------|----------|
| eCl@ss 10.0.1 | 27060311 |
| eCl@ss 4.0 | 27060300 |
| eCl@ss 4.1 | 27060300 |
| eCl@ss 5.0 | 27061800 |
| eCl@ss 5.1 | 27061800 |
| eCl@ss 6.0 | 27279200 |
| eCl@ss 7.0 | 27279218 |
| eCl@ss 8.0 | 27279218 |
| eCl@ss 9.0 | 27060311 |

Master cable - SAC-12P- 5,0-PUR/M16FR - 1693720

Classifications

ETIM

| | |
|----------|----------|
| ETIM 2.0 | EC000104 |
| ETIM 3.0 | EC000104 |
| ETIM 4.0 | EC001855 |
| ETIM 5.0 | EC001855 |
| ETIM 6.0 | EC001855 |
| ETIM 7.0 | EC001855 |

UNSPSC

| | |
|---------------|----------|
| UNSPSC 6.01 | 31251501 |
| UNSPSC 7.0901 | 31251501 |
| UNSPSC 11 | 31251501 |
| UNSPSC 12.01 | 31251501 |
| UNSPSC 13.2 | 31251501 |
| UNSPSC 19.0 | 31251501 |
| UNSPSC 20.0 | 31251501 |
| UNSPSC 21.0 | 31251501 |

Approvals

Approvals

Approvals

EAC

Ex Approvals

Approval details

| | | |
|-----|---|----------|
| EAC |  | 19060508 |
|-----|---|----------|
